

ATyS p M

Automatic
Transfer Switching Equipment

Preliminary operations

- Check the following upon delivery and after removal of the packaging:
- Packaging and contents are in good condition.
 - The product reference corresponds to the order.
 - Contents should include:
 - Qty 1 x ATyS M
 - Qty 1 x Emergency handle extension rod
 - Qty 1 x Set of terminals
 - Quick Start instruction sheet

Warning

- Risk of electrocution, burns or injury to persons and / or damage to equipment.**
- This Quick Start is intended for personnel trained in the installation and commissioning of this product. For further details refer to the product instruction manual available on the SOCOMEC website.
- This product must always be installed and commissioned by qualified and approved personnel.
- Maintenance and servicing operations should be performed by trained and authorised personnel.
- Do not handle any control or power cables connected to the product when voltage may be, or may become present on the product, directly through the mains or indirectly through external circuits.
- Always use an appropriate voltage detection device to confirm the absence of voltage.
- Ensure that no metal objects are allowed to fall in the cabinet (risk of electrical arcing).
- Failure to observe good engineering practises as well as to follow these safety instructions may expose the user and others to serious injury or death.
- Risk of damaging the device**
- In case the product is dropped or damaged in any way it is recommended to replace the complete product.



Accessories

- Bridging bars 125A or 160A.
- Control voltage transformer (400Vac -> 230Vac).
- Voltage sensing and power supply tap.
- Terminal shrouds.
- Auxiliary contact blocks.
- Polycarbonate enclosure.
- Polycarbonate extension box.
- Power Connection Terminals.
- ATyS D10 remote display unit.
- ATyS D20 remote control and display unit.



www.socomec.com
www.socomec.com/en/atys-p-m
To download, brochures, catalogues and technical manuals.
Printing informations: 1 color Black. White paper 90g/m².
Printing size: 420x297. Final size 210x297. This page visible first.
A separate sheet for each language.

Installation and Commissioning

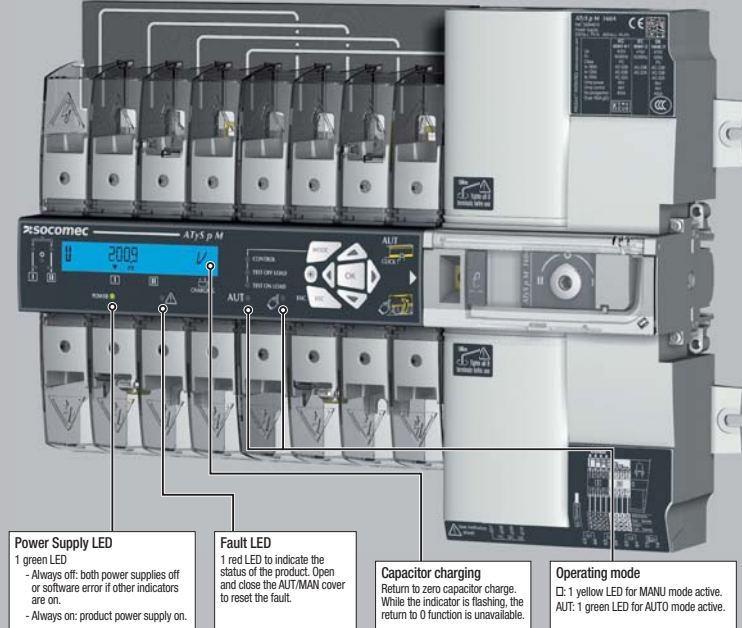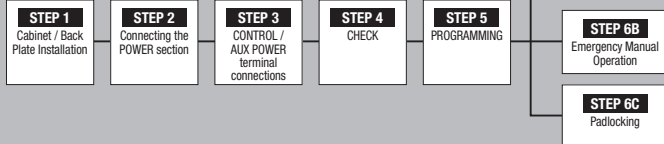




STEP 3 CONTROL / AUX POWER Terminals and wiring

Type	Terminal no.	Description	Characteristics	Recommended connection cross-section
Inputs	207	Common point for inputs		
	208	I1: programmable input	Do not connect to any power supply	0.5 to 2.5 mm ² (rigid)
	209	I2: programmable input	Supply from the product	
	210	I3: programmable input		
Outputs	43/44	O1: programmable output	Resistive load 2A 30Vdc	0.5 to 1.5 mm ² (stranded)
	53/54	O2: programmable output	0.5A 230Vac	
	63/64	O3: programmable output	Pmax: 60W or 115VA	
	73/74	G: generator stat signal	Umax: 30Vdc or 230Vac	
Remote interface connection	RJ	ATyS D10/D20 human/machine interface	Maximum distance 3 m	RJ45 8/8 straight cable Cat. 5
Serial connection (specific version)	RS485	Connection RS485 0: interconnection of cable shielding upstream and downstream of RS485 bus -: negative terminal of RS485 bus +: positive terminal of RS485 bus	RS485 bus insulated	LYCY shielded twisted pair, 0.5 to 2.5 mm ²


Type	Terminal no.	Status of the contact	Description	Output characteristics	Recommended connection cross-section
Auxiliary contact block 1309 0001	11/12/14	11 — 14 12	Changeover switch in position I	250V AC 5A AC1 - 30 Vdc 5A	0.5 to 2.5 mm ² (rigid)
	21/22/24	21 — 24 22	Changeover switch in position II		
	01/02/04	01 — 04 02	Changeover switch in position 0		
Auxiliary contact block 1309 0011	11/12/14	11 — 14 12	Changeover switch in position I	250V AC 5A AC1 - 30 Vdc 5A	0.5 to 1.5 mm ² (stranded)
	21/22/24	21 — 24 22	Changeover switch in position II		
	01/02/04	01 — 04 02	Changeover switch in position 0		

STEP 1 Installation


Caution: Ensure that the product is installed on a flat rigid surface.

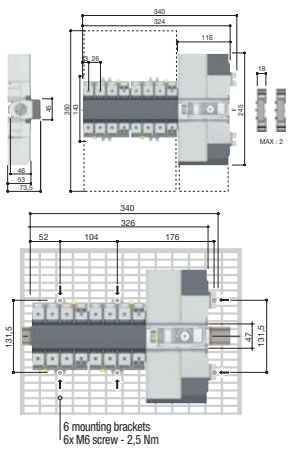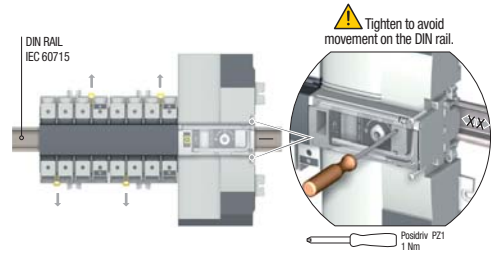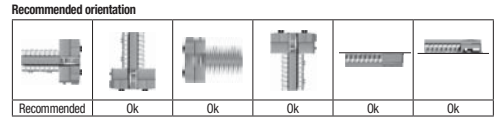



Padlocking configuration

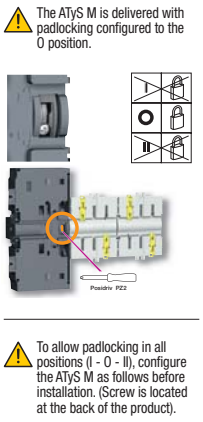



STEP 2 Power Terminal Connections

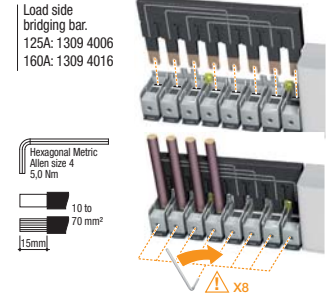


Voltage taps provide 2x ≤ 1.5mm² connections. They can be fitted in any terminals on the source supply side. Do not use on the load side when equipped with a bridging bar.

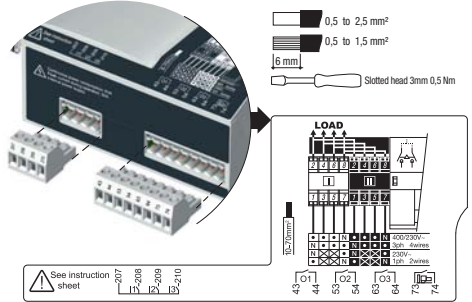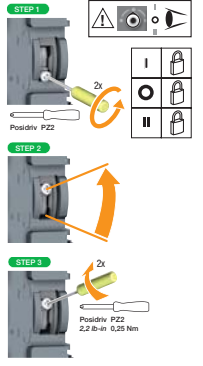

Ensure that the product is in Manual Mode (front cover open).

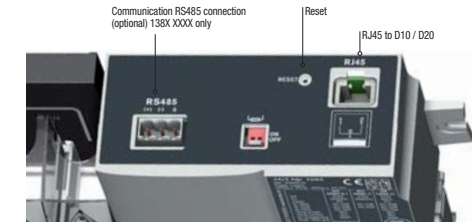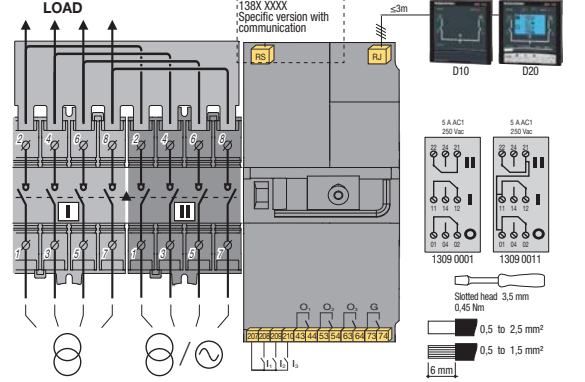

Auxiliary contacts: Fitting of auxiliary contacts: 1309 0001 or 1309 0011
To fit an AC, the switch must first be put in position 0. An auxiliary contact module comprises: one NO/ NC changeover contact for each position (I-0-II). To install use the long screws supplied with the module.

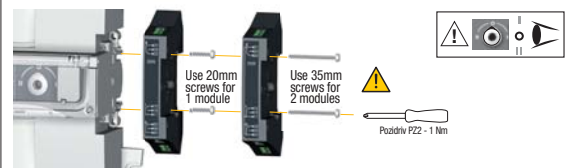

STEP 4

Check



Whilst in manual mode, check the wiring and if ok power up the product.




STEP 5

Programming

Product programming
Programming access is possible in Automatic mode, when the product is in position I with source 1 available, and in Manual mode in any position and with at least one available source.


Note: For complete programming details: download the instruction manual from the Socomec website.

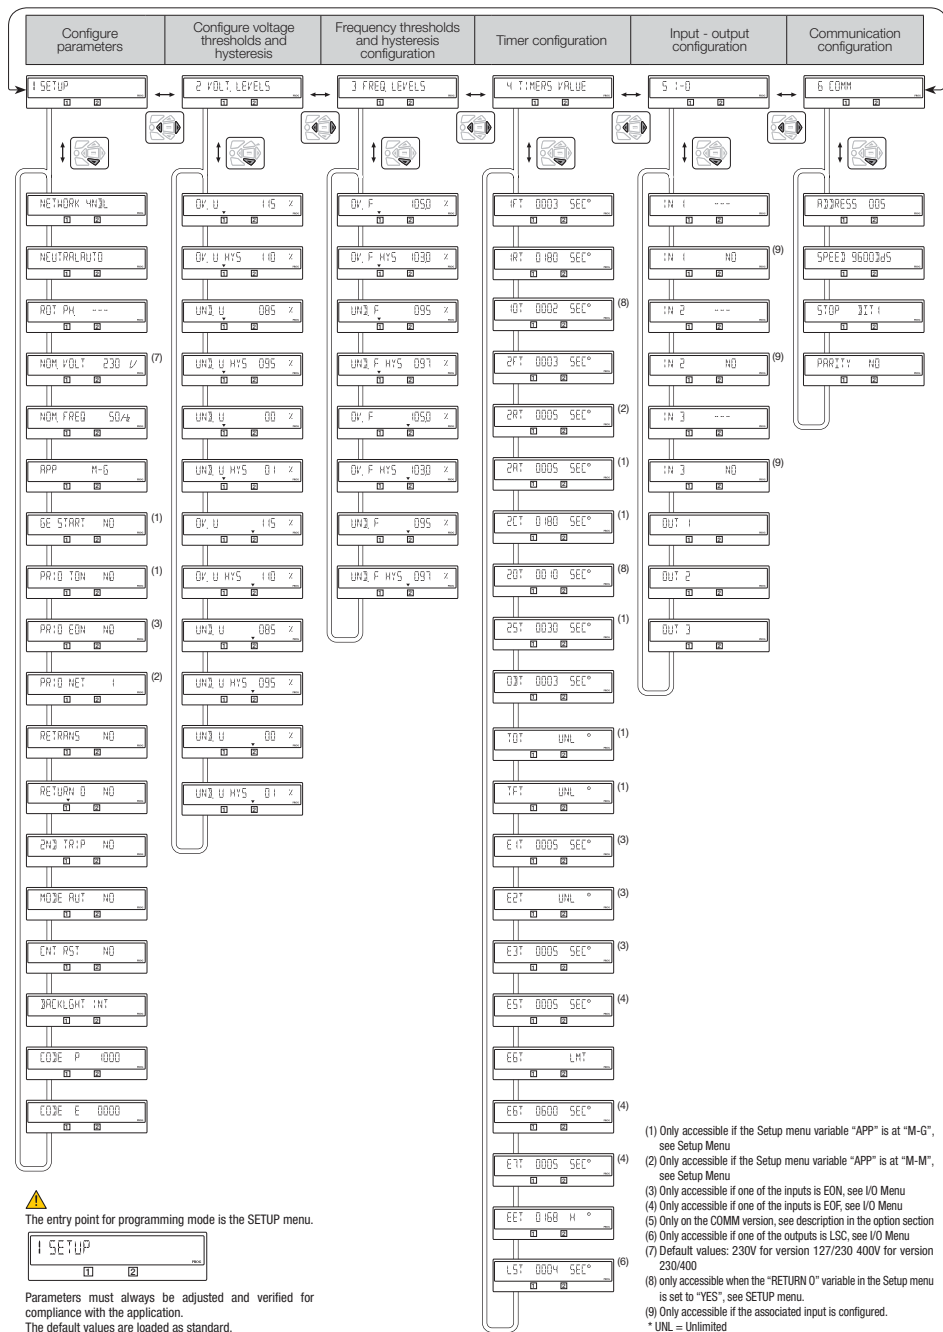


- (1) Only accessible if the Setup menu variable "APP" is at "M-G", see Setup Menu
 - (2) Only accessible if the Setup menu variable "APP" is at "M-M", see Setup Menu
 - (3) Only accessible if one of the inputs is EON, see I/O Menu
 - (4) Only accessible if one of the inputs is EOF, see I/O Menu
 - (5) Only on the COMM version, see description in the option section
 - (6) Only accessible if one of the outputs is LSC, see I/O Menu
 - (7) Default values: 230V for version 127/230 400V for version 230/400
 - (8) Only accessible when the "RETURN 0" variable in the Setup menu is set to "YES", see SETUP menu.
 - (9) Only accessible if the associated input is configured.
- * UNL = Unlimited

To access programming

Default code: 1000

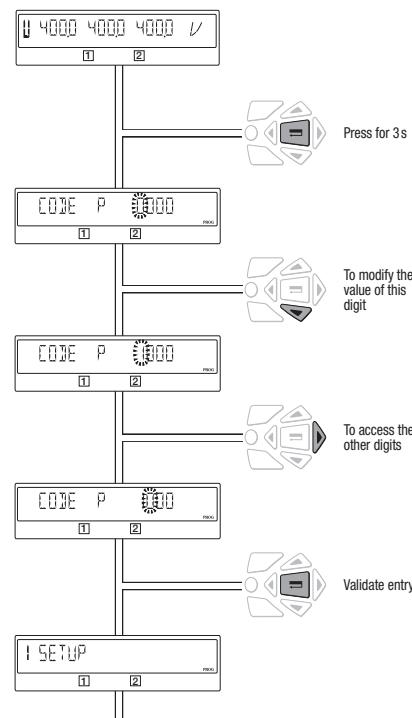

Browsing

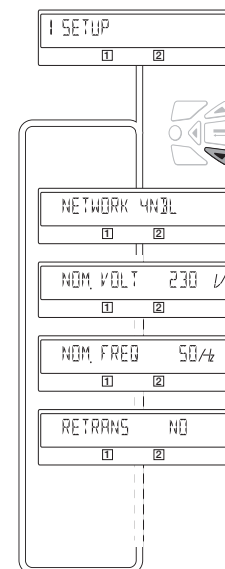

Exit programming



STEP 6A

Automatic operation


Close the front cover as shown to put the product into automatic mode.



STEP 6B

Manual operation


- Open the front cover as shown to put into manual mode.
- Use the handle situated in the front panel under the cover to operate the transfer switch.
- Check the changeover switch position on the indicator before operating.



STEP 6C

Padlocking mode

- In order to padlock put the product in manual mode.
- Pull the locking mechanism and insert a padlock as shown.
- As standard padlocking in the 0 position. Configurable to I-0-II (see step 1).



TIMERS		Setting range	Default Value
1FT	Loss of source 1 Validation timer.	0 to 60 sec	3 sec
1RT	Source 1 return validation timer.	0 to 3600 sec	180 sec
2FT	Loss of source 2 Validation timer.	0 to 60 sec	3 sec
2RT	Source 2 return validation timer.	0 to 60 sec	5 sec
2AT	Standby network stability validation before transfer	0 to 60 sec	5 sec
2CT	Run on timer.	0 to 600 sec	180 sec
ODT	Dead band timer.	0 to 20 sec	3 sec
Parameters		Setting range	Default value
NEUTRAL	Neutral position on the switch AUTO: neutral position is automatically detected when the product is supplied the first time. LEFT: neutral must be connected to the left that means on the terminal 1 from each switch. RIGHT: neutral must be connected to the right that means on the terminal 7 from each switch.	AUTO LEFT RIGHT	AUTO
NOM. VOLT.	Nominal voltage Phase/phase or phase/neutral in 1BL and 41NBL	From 180 to 480 Vac	400Vac (230/400V version) 230Vac (127/230V version)
NOM. FREQ.	Nominal Frequency	50 or 60Hz	50Hz
APP	Type of application M-G: network - Genset M-M: network - network	M-G M-M	M-G
RETRANS	Retransfer inhibit feature, press on Validation button required to allow retransfer from Gen to Main	YES or NO	NO
NETWORK	Network configuration*	3NBL / 4NBL / 41NBL / 1BL (230/400V version) 4NBL / 3NBL / 2NBL / 42NBL (127/230V version)	4NBL

* The wiring must be adapted to the network configuration. Below, the main configuration types.

